



## GREASE INTERCEPTOR CERTIFICATION (Form A)

### City of Mt. Juliet Wastewater Department

Every food service establishment in the City of Mt. Juliet, TN sewage service area must have their grease interceptor certified annually, to verify that all components of the grease control equipment are present and in good working condition. Furthermore, the inspection will identify any structural problems with the grease interceptor.

Facility Name: \_\_\_\_\_ Phone #: \_\_\_\_\_

Address: \_\_\_\_\_ City: \_\_\_\_\_, TN. Zip Code \_\_\_\_\_

	<u>PASS</u>	<u>FAIL*</u>
1. Interceptor completely emptied and cleaned before inspection?	<input type="checkbox"/>	<input type="checkbox"/>
2. There is access to all interceptor chambers for cleaning and inspections?	<input type="checkbox"/>	<input type="checkbox"/>
3. Influent (inlet) T is attached and extends downward at least 2/3 depth of tank?	<input type="checkbox"/>	<input type="checkbox"/>
4. Effluent (outlet) T is attached and extends downward to within 12" of tank bottom?	<input type="checkbox"/>	<input type="checkbox"/>
5. Effluent (outlet) T is made of non-collapsible material that does <u>not</u> easily flex or bend (i.e. minimum schedule 40 PVC, etc.), and is secure, not allowing fats, oils or grease to escape around edges?	<input type="checkbox"/>	<input type="checkbox"/>
6. Interceptor tank does <u>Not</u> have visible holes or leaks?	<input type="checkbox"/>	<input type="checkbox"/>
7. Mid-wall baffle(s) is secure and operational?	<input type="checkbox"/>	<input type="checkbox"/>
8. Interceptor maintaining structural integrity?	<input type="checkbox"/>	<input type="checkbox"/>
9. No Sewer clean-out covers missing or damaged?	<input type="checkbox"/>	<input type="checkbox"/>

M  
U  
S  
T  
  
C  
O  
M  
P  
L  
E  
T  
E  
  
A  
L  
L  
  
I  
N  
F  
O  
R  
M  
A  
T  
I  
O  
N

**\* IMPORTANT REQUIRED INFORMATION & RESPONSE:** If the answer to any of the above questions is "Fail", the equipment has failed certification. A statement of the plan of action to be taken, with date to be completed, needs to be provided on the attached sheet under "Response Comments" (attach additional sheets to explain corrective action if necessary):

**Inspector Certification** – This grease interceptor has  PASSED  FAILED certification.


I \_\_\_\_\_ of \_\_\_\_\_  
(print name of inspector) (print company name)  
 certify that the above listed facility has an approximate \_\_\_\_\_ gallon capacity interceptor. I have examined the interceptor and provided the above information.

\_\_\_\_\_  
(signature) (date) (phone number)

**Facility Owner/Manager Certification**

I \_\_\_\_\_ certify to the best of my knowledge the above  
(print name)  
 statements to be true and correct. \_\_\_\_\_  
(signature) (date)

*Grease Interceptor Diagram*

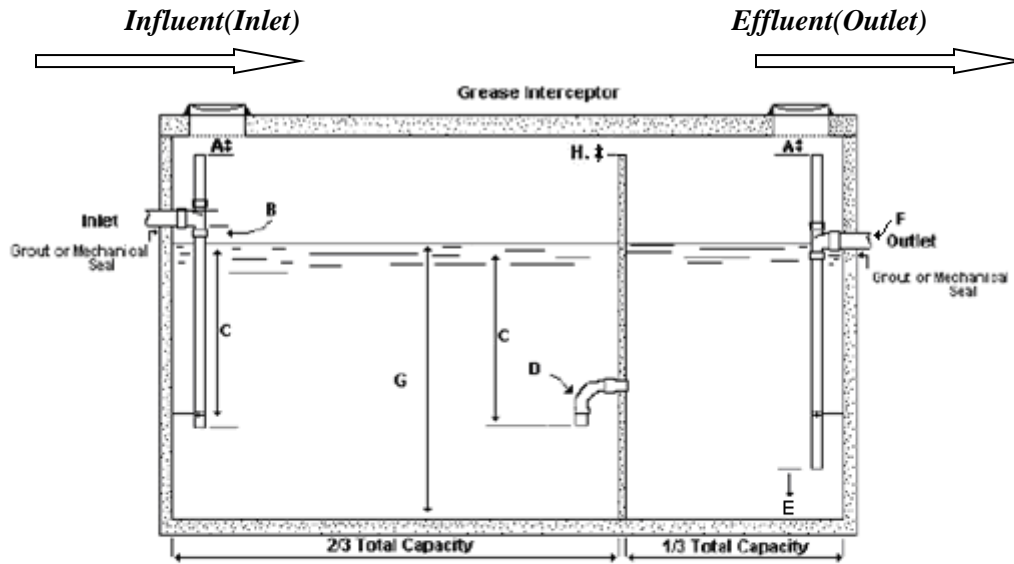

- A.) Minimum 6" , but not less than pipe diameter.
- B.) Inlet pipe invert to be 2 1/2" above liquid surface.
- C.) Inlet pipe to terminate 2/3 depth of water level.
- D.) 90 degree Sweep, minimum size - 6" and same depth as inlet pipe
- E.) 12" from floor to end of outlet pipe.
- F.) Outlet pipe no smaller than inlet pipe, minimum - 4".
- G.) Minimum depth of liquid capacity - 42".
- H.) Maximum distance from ceiling - 6".

***RESPONSE COMMENTS (required if "Fail" checked, identify problem, corrective action and provide planned date of corrective action)***

---



---



---



---



---



---



---



---



---



---